

Simulation of PV Based Grid Connected Inverter with Fuzzy Based Unified Control Strategy

T. Sripal Reddy

Associate professor & HoD
Department of Electrical &
Electronics Engineering,
Sarada Institute of Technology &
science,
Khammam, Telangana, India.

G. Ravi

Associate Professor
Department of Electrical &
Electronics Engineering,
Sarada Institute of Technology &
science,
Khammam, Telangana, India.

B. Veerabhadram

M.Tech Student
Department of Electrical &
Electronics Engineering,
Sarada Institute of Technology &
science,
Khammam, Telangana, India.

ABSTRACT

Distributed generation (DG) is emerging as a viable alternative when renewable or nonconventional energy resources are available, such as wind turbines, photovoltaic arrays, fuel cells, micro turbines. Most of these resources are connected to the utility through power electronic interfacing converters, i.e., three-phase inverter. DG is a suitable form to offer high reliable electrical power supply, as it is able to operate either in the grid-tied mode or in the islanded mod. In the grid-tied operation, DG deliveries power to the utility and the local critical load. The proposed control strategy composes of an inner inductor current loop, and a novel voltage loop in the synchronous reference frame. The inverter is regulated as a current source just by the inner inductor current loop in grid-tied operation, and the voltage controller is automatically activated to regulate the load voltage upon the occurrence of islanding. To create a stable mode when different kinds of loads are connected locally or when working under contingency, the step-up converter must regulate the dc link voltage, allowing the VSI to stabilize its terminal voltage. PI and fuzzy controllers are used to regulate voltages and currents, while a phase-locked loop algorithm is used to synchronize the grid and DG.

Index Terms— Unified Power Quality Conditioner, Three Phase Inverter, Distributed generation (DG), islanding, load current, seamless transfer.

Introduction

In contemporary world interconnection of distributed generations (DG) which operate in parallel with electrical power networks, is currently changing the paradigm we are used to live with. Distributed generation is gaining worldwide interest because of environmental issues and rising in energy prices and power plant construction costs. Distributed generations are relatively small and many of them make use of renewable energy such as fuel cells, gas turbines, micro-hydro, wind turbines and photovoltaic. Many DGs use power electronic inverters, instead of rotating generators. The inverters typically have fast current limiting functions for self protection, and may not be damaged by out-of-phase reclosing. The operation of distributed generation will enhance the power quality in power system and this interconnection especially with reverse power flow may lead to some problems like voltage and frequency deviation, harmonics, reliability of the power system and islanding phenomenon. Islanding is one of the most technical concerns associated with the proliferation of distributed generation connected to utility networks. Islanding can be defined as a condition in which a portion of the utility system contains both load and distributed generation remains energized while being isolated from the remainder of the utility system. Islanding detection is a mandatory feature for grid-connected inverters as specified in international standards and guidelines. Inverters usually operate with current control and unity power factor and employ passive monitoring for islanding detection methods based on locally measured

parameters. Under islanding conditions, the magnitude and frequency of the voltage at the point of common coupling (PCC) tend to drift from the rated grid values as a function of the power imbalance (ΔP and ΔQ). As it is known that distribution system does not have any active power generating source and does not receive power in case of a fault in transmission line.

However, with Distributed Generation this presumption is no longer valid. In current practice DG is required to disconnect the utilities from the grid in case of islanding. The main issues about islanding are:

- 1). Safety issues since a portion of the system remains energized while it is not expected.
- 2). Islanded system may be inadequately grounded by the DG interconnection.
- 3). Instantaneous reclosing could cause out of phase in the system.
- 4). Loss of control over voltage and frequency in the system.
- 5). Excessive transient stresses upon reconnection to the grid.
- 6). Uncoordinated protection.

The strategy of islanding detection is to monitor the DG output parameters for the system and based on the measurements decide whether an islanding situation has occurred from monitoring of these parameters. Islanding detection techniques can be divided into remote and local techniques.

A multilevel inverter is a power electronic system that synthesizes a desired output voltage from several levels of dc voltages as inputs. Recently, multilevel power conversion technology has been developing the area of power electronics very rapidly with good potential for further developments. As a result, the most attractive applications of this technology are in the medium to high voltage ranges [3].

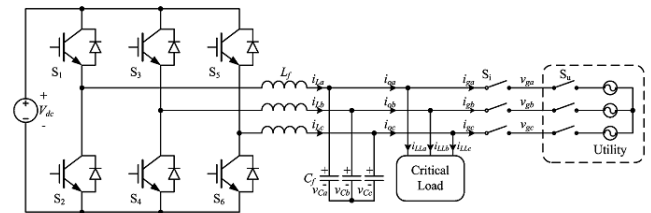


Fig. 1. Schematic diagram of the DG based on the proposed control strategy.

Its applications are in the field of high-voltage high-power applications such as laminators, mills, conveyors, compressors, large induction motor drives, UPS systems, and static var compensation. Its working principle is based on producing small output voltage steps which results in better power quality. They operate at low voltage levels and also at a low switching frequency so that the switching losses are also reduced.

The principle includes as the number of levels in the inverter increases, the output voltage has more step generation i.e. staircase waveform, which has a reduced harmonic distortion. The main disadvantage of number of levels includes more number of switching devices, diodes, and other passive elements. Hence inverter becomes bulky, more control complexity and introduces voltage-imbalance. To solve the above problem, an asymmetric topology H-bridge inverter with three unequal DC sources is used. This topology has the capability of utilizing different DC voltages on the individual H-bridge cells.

A. Passive methods

This method is fast to detect the islanding. But it has large non detection zone and it need special care to set the thresholds for it is parameters. Passive method can classified into: Rate of change of output power, Rate of change of frequency, rate of change of frequency over power, Change of impedance, voltage unbalance, and harmonic distortion

B. Active Methods

Active method tries to overcome the shortcomings of passive methods by introducing perturbations in the inverter output. Active method can detect the islanding

even under the perfect match of generation and load, which is not possible in case of the passive detection schemes but it caused degradation of power quality. Active method can be classified into: Reactive power export error detection, Impedance measurement method, Phase (or frequency) shift methods, Active Frequency Drift, Active Frequency Drift with Positive Feedback Method, Adaptive Logic Phase Shift, Current injection with positive feedback.

C.Hybrid Methods

Hybrid method based on implementing of two assortment of active and passive method. The active technique is implemented only when the islanding is suspected by the passive technique. It can be classified into: Technique based on voltage and reactive power shift, Technique based on positive feedback and voltage imbalance. In current into the utility for mitigating the harmonic component of the grid current, is presented. General, once the main grid source supply is lost the DG has to take charge of the remaining network and the connected loads. Passive detection scheme, on the other hand, monitors parameters for detecting the islanding operations of DG: voltage unbalance, frequency, active and reactive power along with total harmonic distortion (THD).

In the hybrid voltage and current mode control, there is a need to switch the controller when the operation mode of DG is changed. During the interval from the occurrence of utility outage and switching the controller to voltage mode, the load voltage is neither fixed by the utility, nor regulated by the DG, and the length of the time interval is determined by the islanding detection process. Therefore, the main issue in this approach is that it makes the quality of the load voltage heavily reliant on the speed and accuracy of the islanding detection method [6]–[10]. Another issue associated with the aforementioned approaches is the waveform quality of the grid current and the load voltage under nonlinear local load. In the grid-tied mode, the output current of DG is generally desired to be pure sinusoidal [18].

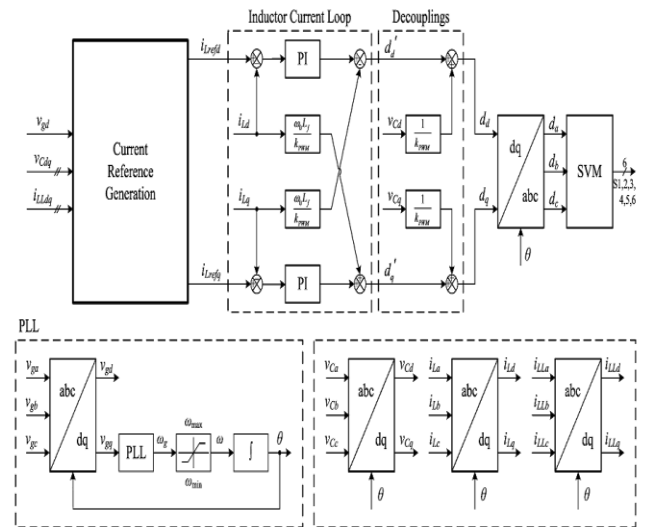


Fig. 2. Overall block diagram of the proposed unified control strategy

When the nonlinear local load is fed, the harmonic component of the load current will fully flow into the utility. The voltage mode control is enhanced by controlling the DG to emulate a resistance at the harmonic frequency, and then the harmonic current flowing into utility can be mitigated. This paper proposes a unified control strategy that avoids the aforementioned shortcomings. First, the traditional inductor current loop is employed to control the three-phase inverter in DG to act as a current source with a given reference in the synchronous reference frame (SRF). Second, a novel voltage controller is presented to supply reference for the inner inductor current loop, where a proportional-plus-integral (PI) compensator and a proportional (P) compensator are employed in D-axis and Q-axis, respectively. In the grid-tied operation, the load voltage is dominated by the utility, and the voltage compensator in D-axis is saturated, while the output of the voltage compensator in Q-axis is forced to be zero by the PLL. Therefore, the reference of the inner current loop cannot be regulated by the voltage loop, and the DG is controlled as a current source just by the inner current loop. Moreover, the proposed control strategy, benefiting from just utilizing the current and voltage feedback control, endows a better dynamic performance, compared to the voltage mode control.

PROPOSED CONTROL STRATEGY

A. Power Stage

This paper presents a unified control strategy for a three phase inverter in DG to operate in both islanded and grid-tied modes. The schematic diagram of the DG based on the proposed control strategy is shown by Fig. 1. The DG is equipped with a three-phase interface inverter terminated with a LC filter. The primary energy is converted to the electrical energy, which is then converted to dc by the front-end power converter, and the output dc voltage is regulated by it. Therefore, they can be represented by the dc voltage source V_{dc} in Fig. 1. In the ac side of inverter, the local critical load is connected directly. It should be noted that there are two switches, denoted by S_u and S_i , respectively, in Fig. 1, and their functions are different.

The inverter transfer switch S_i is controlled by the DG, and the utility protection switch S_u is governed by the utility. When the utility is normal, both switches S_i and S_u are ON, and the DG in the grid-tied mode injects power to the utility. When the utility is in fault, the switch S_u is tripped by the utility instantly, and then the islanding is formed. After the islanding has been confirmed by the DG with the islanding detection scheme [6]–[10], the switch S_i is disconnected, and the DG is transferred from the grid-tied mode to the islanded mode. When the utility is restored, the DG should be resynchronized with the utility first, and then the switch S_i is turned ON to connect the DG with the grid.

B. Basic Idea

With the hybrid voltage and current mode control [17], the inverter is controlled as a current source to generate the reference power $P_{DG}+jQ_{DG}$ in the grid-tied mode. And its output power $P_{DG}+jQ_{DG}$ should be the sum of the power injected to the grid $P_g + jQ_g$ and the load demand $P_{load} + jQ_{load}$, which can be expressed as follows by assuming that the load is represented as a parallel RLC circuit:

$$P_{load} = \frac{3}{2} \cdot \frac{V_m^2}{R} \quad (1)$$

$$Q_{load} = \frac{3}{2} \cdot V_m^2 \cdot \left(\frac{1}{\omega L} - \omega C \right) \quad (2)$$

In (1) and (2), V_m and ω represent the amplitude and frequency of the load voltage, respectively. When the nonlinear local load is fed, it can still be equivalent to the parallel RLC circuit by just taking account of the fundamental component.

During the time interval from the instant of islanding happening to the moment of switching the control system to voltage mode control, the load voltage is neither fixed by the utility nor regulated by the inverter, so the load voltage may drift from the normal range [6]. And this phenomenon can be explained as below by the power relationship. During this time interval, the inverter is still controlled as a current source, and its output power is kept almost unchanged. However, the power injected to utility decreases to zero rapidly, and then the power consumed by the load will be imposed to the output power of DG. If both active power P_g and reactive power Q_g injected into the grid are positive in the grid-tied mode, then P_{load} and Q_{load} will increase after the islanding happens, and the amplitude and frequency of the load voltage will rise and drop, respectively, according to (1) and (2). With the previous analysis, if the output power of inverter $P_{DG}+jQ_{DG}$ could be regulated to match the load demand by changing the current reference before the islanding is confirmed, the load voltage excursion will be mitigated. And this basic idea is utilized in this paper. In the proposed control strategy, the output power of the inverter is always controlled by regulating the three-phase inductor current i_{Labc} , while the magnitude and frequency of the load voltage v_{cabc} are monitored. When the islanding happens, the magnitude and frequency of the load voltage may drift from the normal range, and then they are controlled to recover to the normal range automatically by regulating the output power of the inverter.

C. Control Scheme

Fig. 2 describes the overall block diagram for the proposed unified control strategy, where the inductor current i_{Labc} , the utility voltage v_{gabc} , the load

voltage v_{cabc} , and the load current i_{LLabc} are sensed. And the three-phase inverter is controlled in the SRF, in which, three phase variable will be represented by dc quantity. The control diagram is mainly composed by the inductor current loop, the PLL, and the current reference generation module.

In the inductor current loop, the PI compensator is employed in both D- and Q-axes, and a decoupling of the cross coupling denoted by $\omega_0 L f/k$ PWM is implemented in order to mitigate the couplings due to the inductor. The output of the inner current loop dq, together with the decoupling of the capacitor voltage denoted by $1/k$ PWM, sets the reference for the standard space vector modulation that controls the switches of the three-phase inverter. It should be noted that k PWM denotes the voltage gain of the inverter, which equals to half of the dc voltage in this paper.

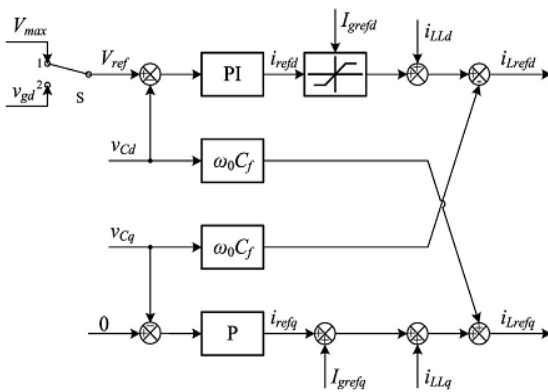


Fig.3. Block diagram of the current reference generation module.

The PLL in the proposed control strategy is based on the SRF PLL, which is widely used in the three-phase power converter to estimate the utility frequency and phase. Furthermore, a limiter is inserted between the PI compensator GPL Land the integrator, in order to hold the frequency of the load voltage within the normal range in the islanded operation.

In Fig. 2, it can be found that the inductor current is regulated to follow the current reference i_{Lrefdq} , and the phase of the current is synchronized to the grid voltage v_{gabc} . If the current reference is constant, the inverter is just controlled to be a current source, which is the same with the traditional grid-tied inverter. The

new part in this paper is the current reference generation module shown in Fig. 2, which regulates the current reference to guarantee the power match between the DG and the local load and enables the DG to operate in the islanded mode. Moreover, the unified load current feed forward, to deal with the nonlinear local load, is also implemented in this module.

The block diagram of the proposed current reference generation module is shown in Fig. 3, which provides the current reference for the inner current loop in both grid-tied and islanded modes. In this module, it can be found that an unsymmetrical structure is used in D- and Q-axes. The PI compensator is adopted in D-axes, while the P compensator is employed in Q-axis. Besides, an extra limiter is added in the D-axis. Moreover, the load current feed forward is implemented by adding the load current i_{LLdq} to the final inductor current reference i_{Lrefdq} . The benefit brought by the unique structure in Fig. 3 can be represented by two parts: 1) seamless transfer capability without critical islanding detection; and 2) power quality improvement in both grid-tied and islanded operations. The current reference i_{Lrefdq} composes of four parts in D-and Q-axes respectively:

- 1) the output of voltage controller i_{refdq} ;
- 2) the grid current reference I_{grefdq} ;
- 3) the load current i_{LLdq} ; and
- 4) the current flowing through the filter capacitor C_f .

In the grid-tied mode, the load voltage $v_c dq$ is clamped by the utility. The current reference is irrelevant to the load voltage, due to the saturation of the PI compensator in D-axis, and the output of the P compensator being zero in Q-axis, and thus, the inverter operates as a current source. Upon occurrence of islanding, the e voltage by regulating the current reference, and the inverter acts as a voltage source to supply stable voltage to the local load; this relieves the need for switching between different control architectures. Another distinguished function of the current reference generation module is the load current feed forward. The sensed load current is added as a part of the inductor current reference i_{Lrefdq} to compensate the harmonic component in the grid

current under nonlinear local load. In the islanded mode, the load current feed forward operates still, and the disturbance from the load current, caused by the nonlinear load, can be suppressed by the fast inner inductor current loop, and thus, the quality of the load voltage is improved.

The inductor current control in Fig. 2 was proposed in previous publications for grid-tied operation of DG [18], and the motivation of this paper is to propose a unified control strategy for DG in both grid-tied and islanded modes, which is represented by the current reference generation module in Fig. 3. The contribution of this module can be summarized in two aspects. First, by introducing PI compensator and P compensator in D-axis and Q-axis respectively, the voltage controller is activated in the grid-tied mode and can be automatically activated upon occurrence of islanding.

Therefore, there is no need for switching different controllers or critical islanding detection, and the quality of the load voltage during the transition from the grid-tied mode to the islanded mode can be improved. The second contribution of this module is to present the load current feed forward to deal with the issue caused by the nonlinear local load, with which, not only the waveform of the grid current in grid-tied is improved, but also the quality of the load voltage in the islanded mode is enhanced. Besides, it should be noted that a three-phase unbalanced local load cannot be fed by the DG with the proposed control strategy, because there is no flow path for the zero sequence current of the unbalanced load, and the regulation of the zero sequence current is beyond the scope of the proposed control strategy.

OPERATING PRINCIPLE OF DG

The operation principle of DG with the proposed unified control strategy will be illustrated in detail in this section, and there are in total four states for the DG, including the grid-tied mode, transition from the grid-tied mode to the islanded mode, the islanded mode, and transition from the islanded mode to the grid-tied mode.

A. Grid-Tied Mode

When the utility is normal, the DG is controlled as a current source to supply given active and reactive power by the inductor current loop, and the active and reactive power can be given by the current reference of D- and Q-axis independently. First, the phase angle of the utility voltage is obtained by the PLL, which consists of a Park transformation expressed by (3), a PI compensator, a limiter, and an integrator

$$\begin{pmatrix} x_d \\ x_q \end{pmatrix} = \frac{2}{3} \begin{pmatrix} \cos \theta & \cos \left(\theta - \frac{2\pi}{3} \right) & \cos \left(\theta + \frac{2\pi}{3} \right) \\ -\sin \theta & -\sin \left(\theta - \frac{2\pi}{3} \right) & -\sin \left(\theta + \frac{2\pi}{3} \right) \end{pmatrix} \times \begin{pmatrix} x_a \\ x_b \\ x_c \end{pmatrix} \quad (3)$$

Second, the filter inductor current, which has been transformed into SRF by the Park transformation, is fed back and compared with the inductor current reference $i_{Lref\ dq}$, and the inductor current is regulated to track the reference $i_{Lref\ dq}$ by the PI compensator G_I . The reference of the inductor current loop $i_{Lref\ dq}$ seems complex and it is explained as below. It is assumed that the utility is stiff, and the three-phase utility voltage can be expressed as

$$\begin{cases} v_{ga} = V_g \cos \theta^* \\ v_{gb} = V_g \cos \left(\theta^* - \frac{2\pi}{3} \right) \\ v_{gc} = V_g \cos \left(\theta^* + \frac{2\pi}{3} \right) \end{cases} \quad (4)$$

Where V_g is the magnitude of the grid voltage, and θ^* is the actual phase angle. By the Park transformation, the utility voltage is transformed into the SRF, which is shown as

$$\begin{cases} v_{gd} = V_g \cos(\theta^* - \theta) \\ v_{gq} = V_g \sin(\theta^* - \theta). \end{cases} \quad (5)$$

v_{gq} is regulated to zero by the PLL, so v_{gd} equals the magnitude of the utility voltage V_g . As the filter capacitor voltage equals the utility voltage in the grid-tied mode, v_{Cd} equals the magnitude of the utility voltage V_g , and v_{Cq} equals zero, too. In the D-axis, the inductor current reference $i_{Lref\ d}$ can be expressed by (6) according to Fig. 3

$$i_{Lref\ d} = I_{gref\ d} + i_{LLd} - \omega_0 C_f \cdot v_{Cq} \quad (6)$$

The first part is the output of the limiter. It is assumed that the given voltage reference V_{max} is larger than the magnitude of the utility voltage V_{Cd} in steady state, so the PI compensator, denoted by G_{Vd} in the following part, will saturate, and the limiter outputs its upper value I_{grefd} . The second part is the load current of D-axis i_{LLd} , which is determined by the characteristic of the local load. The third part is the proportional part $-\omega_0 C_f \cdot v_{Cq}$, where ω_0 is the rated angle frequency, and C_f is the capacitance of the filter capacitor. It is fixed as v_{Cq} depends on the utility voltage. Consequently, the current reference i_{Lrefd} is imposed by the given reference I_{grefd} and the load current i_{LLd} , and is independent of the load voltage.

In the Q-axis, the inductor current reference i_{Lrefq} consists of four parts as

$$i_{Lrefq} = v_{Cq} \cdot k_{Gvq} + I_{grefq} + i_{LLq} + \omega_0 C_f \cdot v_{Cd} \quad (7)$$

Where k_{Gvq} is the parameter of the P compensator, denoted by G_{VQ} in the following part. The first part is the output of G_{VQ} which is zero as the v_{Cq} has been regulated to zero by the PLL. The second part is the given current reference I_{grefq} , and the third part represents the load current in Q-axis. The final part is the proportional part $-\omega_0 C_f \cdot v_{Cd}$, which is fixed since v_{Cd} depends on the utility voltage. Therefore, the current reference i_{Lrefq} cannot be influenced by the external voltage loop and is determined by the given reference I_{grefq} and the load current i_{LLq} .

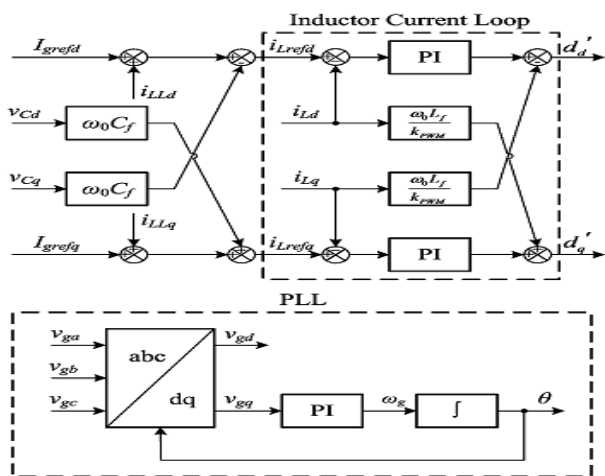


Fig.4. Simplified block diagram of the unified control strategy when DG operates in the grid-tied mode.

With the previous analysis, the control diagram of the inverter can be simplified as Fig. 4 in the grid-tied mode, and the inverter is controlled as a current source by the inductor current loop with the inductor current reference being determined by the current reference I_{grefdq} and the load current i_{LLdq} . In other words, the inductor current tracks the current reference and the load current. If the steady state error is zero, I_{grefdq} represents the grid current actually, and this will be analyzed in the next section.

B. Transition from the Grid-Tied Mode

To the Islanded Mode When the utility switch S_u opens, the islanding happens, and the amplitude and frequency of the load voltage will drift due to the active and reactive power mismatch between the DG and the load demand. The transition, shown in Fig. 5, can be divided into two time interval. The first time intervals are from the instant of turning off S_u to the instant of turning off S_i when islanding is confirmed. The second time interval begins from the instant of turning off inverter switch S_i during the first time interval, the utility voltage v_{gabc} is still the same with the load voltage v_{Cabc} as the switch S_i is in ON state. As the dynamic of the inductor current loop and the voltage loop is much faster than the PLL [52], while the load voltage and current are varying dramatically, the angle frequency of the load voltage can be considered to be not varied. The dynamic process in this time interval can be described by Fig. 6, and it is illustrated later.

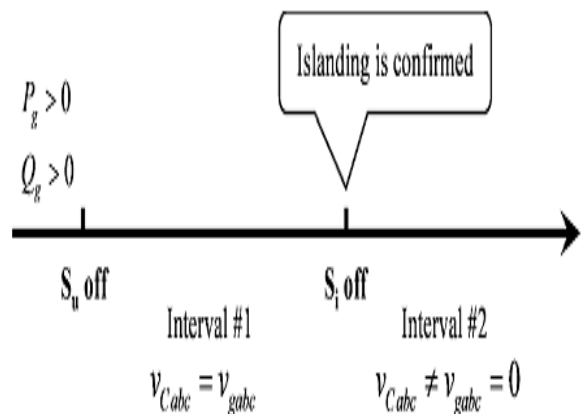


Fig.5. Operation sequence during the transition from the grid-tied mode to the islanded mode.

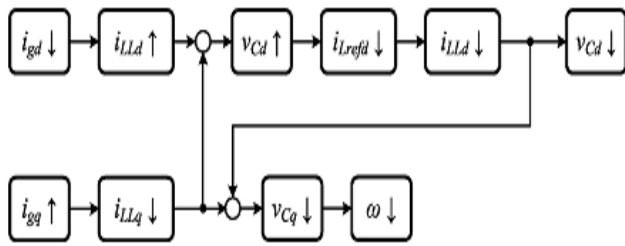


Fig. 6. Transient process of the voltage and current when the islanding happens.

In the grid-tied mode, it is assumed that the DG injects active and reactive power into the utility, which can be expressed by (8) and (9), and that the local critical load, shown in (10), represented by a series connected RLC circuit with the lagging power factor

$$P_g = \frac{3}{2} \cdot (v_{Cd} i_{gd} + v_{Cq} i_{gq}) = \frac{3}{2} v_{Cd} i_{gd} \quad (8)$$

$$Q_g = \frac{3}{2} \cdot (v_{Cq} i_{gd} - v_{Cd} i_{gq}) = -\frac{3}{2} v_{Cd} i_{gq} \quad (9)$$

$$\begin{aligned} Z_{sload} &= R_s + j\omega L_s + \frac{1}{j\omega C_s} \\ &= R_s + j \left(\omega L_s - \frac{1}{\omega C_s} \right) \\ &= R_s + jX_s. \end{aligned} \quad (10)$$

When islanding happens, i_{gd} will decrease from positive to zero, and i_{gq} will increase from negative to zero. At the same time, the load current will vary in the opposite direction. The load voltage in D- and Q-axes is shown by (11) and (12), and each of them consists of two terms. It can be found that the load voltage in D-axis v_{Cd} will increase as both terms increase.

However, the trend of the load voltage in Q-axis v_{Cq} is uncertain because the first term decreases and the second term increases, and it is not concerned for a while

$$v_{Cd} = i_{LLd} \cdot R_s - i_{LLq} \cdot X_s \quad (11)$$

$$v_{Cq} = i_{LLq} \cdot R_s + i_{LLd} \cdot X_s. \quad (12)$$

With the increase of the load voltage in D-axis v_{Cd} , when it reaches and exceeds V_{max} , the input of the PI

compensator GVD will become negative, so its output will decrease. Then, the output of limiter will not imposed to i_{gd} any longer, and the current reference i_{Lrefd} will drop. With the regulation of the inductor current loop, the load current in D-axis i_{LLd} will decrease. As a result, the load voltage in D-axis v_{Cd} will drop and recover to V_{max} . After i_{LLd} has almost fallen to the normal value, the load voltage in Q-axis v_{Cq} will drop according to (12). As v_{Cq} is decreased from zero to negative, then the input of the PI compensator GPLL will be negative, and its output will drop. In other words, the angle frequency ω will be reduced. If it falls to the lower value of the limiter ω_{min} , then the angle frequency will be fixed a ω_{min} .

Consequently, at the end of the first time interval, the load voltage in D-axis v_{Cd} will be increased to and fixed at V_{max} , and the angle frequency of the load voltage ω will drop. If it is higher than the lower value of the limiter ω_{min} , the PLL can still operate normally, and the load voltage in Q-axis v_{Cq} will be zero. Otherwise, if it is fixed at ω_{min} , the load voltage in Q-axis v_{Cq} will be negative. As the absolute values of v_{Cd} and v_{Cq} , at least the one of v_{Cd} , are raised, the magnitude of the load voltage will increase finally.

The variation of the amplitude and frequency in the load voltage can also be explained by the power relationship mentioned before. When the islanding happens, the local load must absorb the extra power injected to the grid, as the output power of inverter is not changed instantaneously. According to (1), the magnitude of the load voltage V_m will rise with the increase of P load. At the same time, the angle frequency ω should drop, in order to consume more reactive power with (2). Therefore, the result through the power relationship coincides with the previous analysis.

The second time interval of the transition begins from the instant when the switch S_i is open after the islanding has been confirmed by the islanding detection method. If the switch S_i opens, the load voltage v_{Cabc} is independent with the grid voltage v_{gabc} . At the same time, v_{gabc} will reduce to zero

theoretically as the switch S_u has opened. Then, the input of the compensator GPLL becomes zero and the angle frequency is invariable and fixed to the value at the end of the first interval. Under this circumstance, v_{Cdq} is regulated by the voltage loop, and the inverter is controlled to be a voltage source. With the previous analysis, it can be concluded that the drift of the amplitude and frequency in the load voltage is restricted in the given range when islanding happens. And the inverter is transferred from the current source operation mode to the voltage source operation mode autonomously.

In the hybrid voltage and current mode control [17], the time delay of islanding detection is critical to the drift of the frequency and magnitude in the load voltage, because the drift is worse with the increase of the delay time. However, this phenomenon is avoided in the proposed control strategy.

C. Islanded Mode

In the islanded mode, switching S_i and S_u are both in OFF state. The PLL cannot track the utility voltage normally, and the angle frequency is fixed. In this situation, the DG is controlled as a voltage source, because voltage compensator GVD and GVQ can regulate the load voltage v_{Cdq} . The voltage references in D and Q-axis are V_{max} and zero, respectively. And the magnitude of the load voltage equals to V_{max} approximately, which will be analyzed in Section IV. Consequently, the control diagram of the three-phase inverter in the islanded mode can be simplified as shown in Fig. 7.

In Fig. 7, the load current i_{LLdq} is partial reference of the inductor current loop. So, if there is disturbance in the load current, it will be suppressed quickly by the inductor current loop, and a stiff load voltage can be achieved.

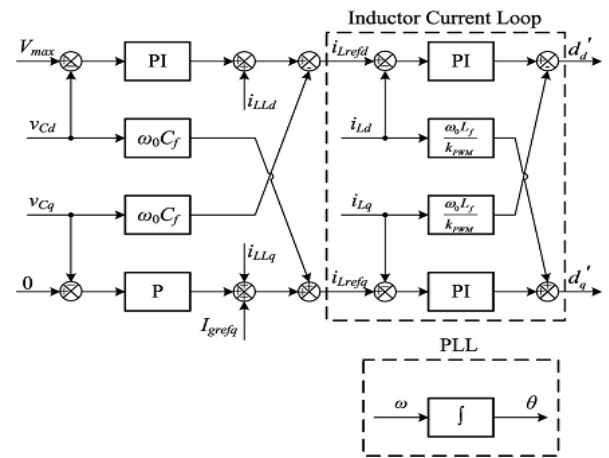


Fig.7.Simplified block diagram of the unified control strategy when DG operates in the islanded mode.

D. Transition from the Islanded Mode

To the Grid-Tied Mode If the utility is restored and the utility switch S_u is ON, the DG should be connected with utility by turning on switch S_i . However, several preparation steps should be performed before turning on switch S First, as soon as utility voltage is restored, the PLL will track the phase of the utility voltage. As a result, the phase angle of the load voltage v_{Cabc} will follow the grid voltage v_{gabc} . If the load voltage v_{Cabc} is in phase with the utility voltage, v_{gd} will equal the magnitude of the utility voltage according to (5). Second, as the magnitude of the load voltage V_{max} is larger than the utility voltage magnitude V_g , the voltage reference V_{ref} will be changed to V_g by toggling the selector S from terminals 1 to 2. As a result, the load voltage will equal to the utility voltage in both phase and magnitude.

Third, the switch S_i is turned on, and the selector S is reset to terminal 1. In this situation, the load voltage will be held by the utility. As the voltage reference V_{ref} equals V_{max} , which PI compensator GVD will saturate, and the limiter outputs its upper value $I_{ref d}$. At the same time, v_{Cq} is regulated to zero by the PLL according to (5), so the output of GVQ will be zero. Consequently, the voltage regulators GVD and GVQ are inactivated, and the DG is controlled as a current source just by the inductor current loop.

IV. FUZZY LOGIC CONTROLLER

Fuzzy logic control is deduced from fuzzy set theory; which was introduced by Zadeh in 1965. In the fuzzy set theory concept, the transition is between membership and non membership function. Therefore, limits or boundaries of fuzzy sets are undefined and ambiguous but useful in approximating systems design. In order to implement the fuzzy logic control algorithm of an active power line conditioner in a closed loop, the dc-link capacitor voltage is sensed and compared with the desired reference value. The error signal $(e(v) V_{dc-ref} V_{dc})$ passes through a Butterworth low pass filter that allows only the fundamental component. The voltage error signal $e(n)$ and change of error signal $ce(n)$ are used as inputs for fuzzy processing as shown in Fig.3. The output of the fuzzy logic controller estimates the magnitude of peak reference current I_{max} .

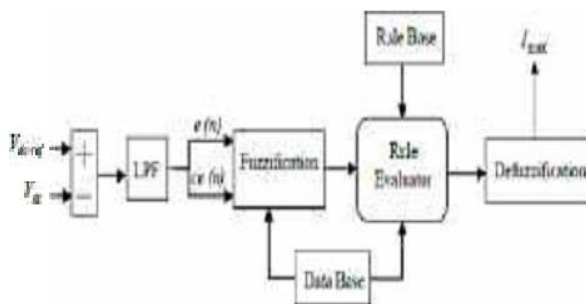



Figure 8: Schematic diagram of the fuzzy logic controller.

- The fuzzy logic controller is characterized as follows:
1. Seven fuzzy sets (NB, NM, NS, ZE, PS, PM, PB) for each input and output variables.
 2. Triangular membership function is used for the implicity.
 3. Implication using Mamdani-type min-operator.
- .Defuzzification using the centroid method.


FUZZIFICATION

Fuzzy logic uses linguistic variables instead of numerical variables. In a closed loop control system, the error signal $e(n)$, change of error signal $ce(n)$ and output of peak reference current I_{max} are considered as membership functions. It can be labeled as Negative Big (NB), Negative Medium (NM), Negative Small (NS), Zero (ZE), Positive Small (PS), Positive

Medium (PM), Positive Big (PB) as shown in Fig.4. Converting numerical variable (real number) into a linguistic variable (fuzzy number) is the process of fuzzification.

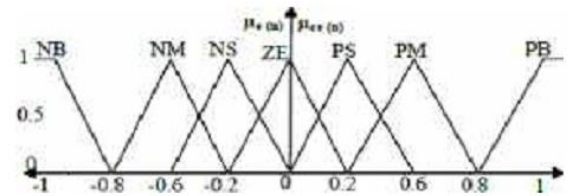

(a)

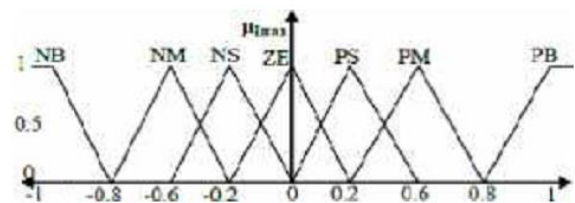

(b)

Figure 9: Membership functions (a) the input variables $e(n)$, $ce(n)$ and (b) output variable I_{max} .

FUZZIFICATION INTERFACE

It transforms the crisp input data into fuzzy values that acts as input to fuzzy reasoning process.

DEFUZZIFICATION

The rules of fuzzy logic produce the set of modified control output in a linguistic variable. The defuzzification module converts these linguistic variables into a crisp value (real number) according to real time applications. The different methods of defuzzification available are Bisector, Centroid, Middle of Maximum (MOM), Smallest of Maximum (SOM) and Largest of Maximum (LOM), etc., however, the selection of method is a compromise between accuracy and computational intensity (that influences hardware requirement for real time application). The centroid (or center of gravity) method is used for simplicity and accuracy. The linguistic output variable from the rule evaluator and definition of output membership are used to calculate the hidden area. Finally, crisp output is obtained by using $output A_i x_i / A_i$.

DEFUZZIFICATION INTERFACE

It converts the fuzzy sets obtained from the inference process into a crisp action that constitutes the global output of the FRBS. Mamdani based fuzzy logic interfacing rule is adopted for correction of power factor. Complex power is taken from power measuring block, in which power angle is taken as input of fuzzy controller. According to power angle control output (firing angle) is provided by fuzzy controller. When power angle is large firing angle is also large. Controlled output is supplied to variable delay circuit and it is supplied to thyristor. According to the output of variable time delay circuit firing angle of thyristor is changed. When power angle is very small then firing angle is also very small. When power angle is medium then firing angle is also medium. When power angle is large then firing angle is also large.

MATLAB/MODELING & RESULTS

Here simulation is carried out in different cases, in that
 1). Proposed Three Phase Three level Inverter Fed Distributed Generation Scheme using Unified Control Scheme.
 2). Proposed Three Phase Five level Inverter Fed Distributed Generation Scheme using Unified Control Scheme.

Case 1: Proposed Three Phase Three level Inverter Fed Distributed Generation Scheme using Unified Control Scheme

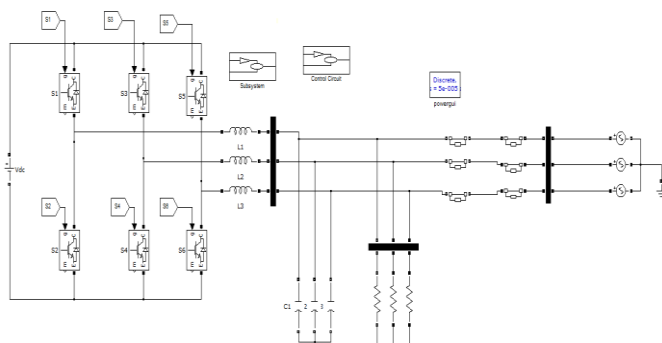


Fig.8 Matlab/Simulink Model of Proposed Three Phase Three level Inverter Fed Distributed Generation Scheme using Unified Control Scheme

Fig.8 shows the Matlab/Simulink Model of Proposed Three Phase Three level Inverter Fed Distributed

Generation Scheme using Unified Control Scheme using Matlab/Simulink tool.

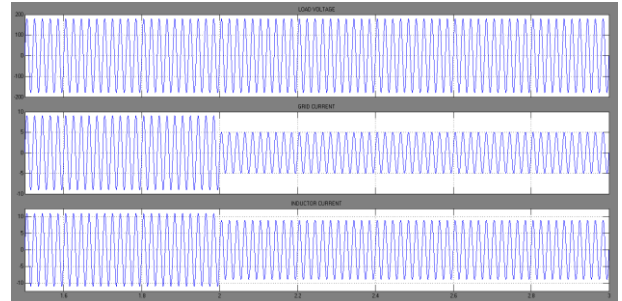


Fig.9. Simulation waveforms of load voltage vCa , grid current iga , and inductor current iLa when DG is in the grid-tied mode under condition of the step down of the grid current reference from 9 A to 5 A with proposed unified control strategy.

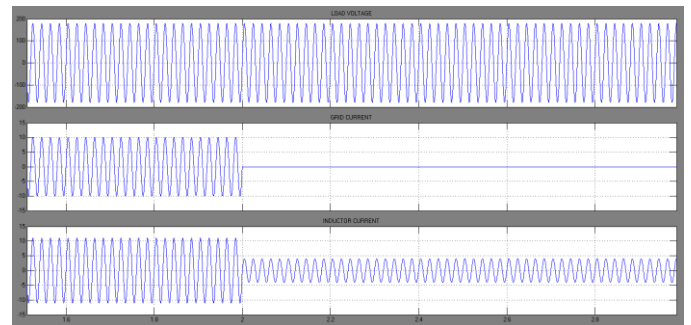


Fig.10. Simulation waveforms of load voltage vCa , grid current iga , and inductor current iLa when DG is transferred from the grid-tied mode to the islanded mode with proposed unified control strategy.

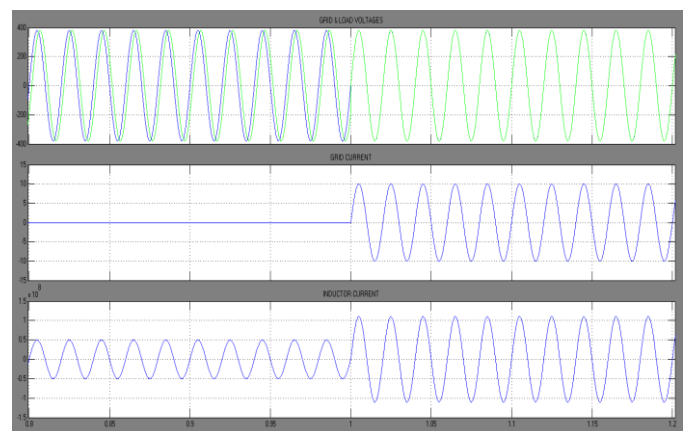


Fig.11 Simulation waveforms under DG is transferred from the islanded mode to the grid-tied mode, grid voltage vga , & load voltage vCa , as well as grid current iga & inductor current iLa .

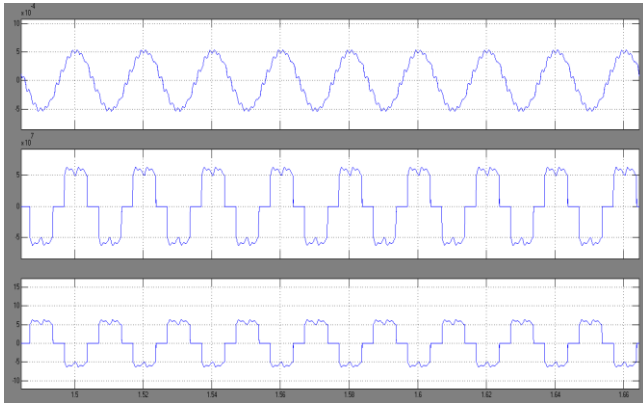


Fig.12 Simulation waveform when DG feeds nonlinear load in islanded mode with load current feed forward.

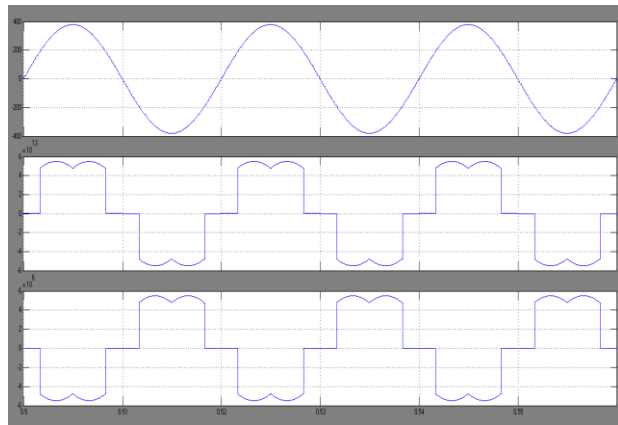


Fig.13 Simulation waveforms when DG feeds nonlinear load in the grid tied mode with load current feed forward control.

Case 2: Proposed Three Phase Multilevel Inverter Fed Distributed Generation Scheme using Unified Control Scheme

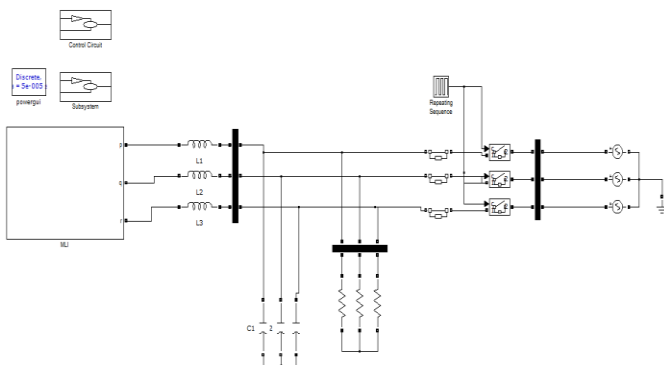


Fig.14 Matlab/Simulink Model of Proposed Three Phase Multilevel Inverter Fed Distributed Generation Scheme using Unified Control Scheme

Fig.14 shows the Matlab/Simulink Model of Proposed Three Phase Multilevel Inverter Fed Distributed Generation Scheme using Unified Control Scheme using Matlab/Simulink tool.

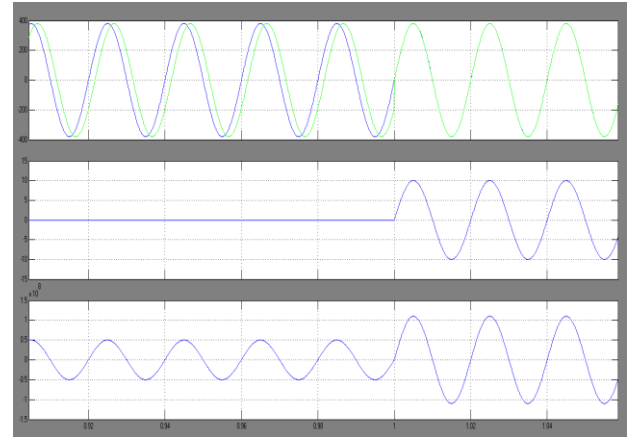


Fig.15 Simulation waveforms under DG is transferred from the islanded mode to the grid-tied mode, grid voltage v_{ga} , & load voltage v_{c_a} , as well as grid current i_{ga} & inductor current i_{La} .

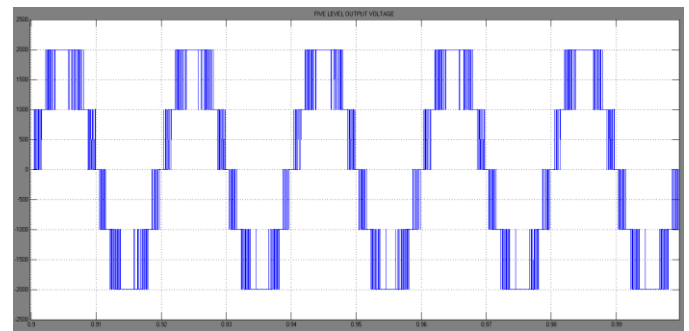


Fig.16 Five Level Output Voltage

Fig.16 shows the Five Level Output Voltage of Proposed Three Phase Multilevel Inverter Fed Distributed Generation Scheme using Unified Control Scheme.

CONCLUSION

The multilevel inverter is a promising inverter topology for high voltage and high power applications. It has the advantages like high power quality waveforms, lower voltage ratings of devices, lower harmonic distortion, lower switching frequency and switching losses, higher efficiency, reduction of dv/dt stresses etc. A novel advanced voltage controller was

presented. It is inactivated in the grid-tied mode, and the DG operates as a current source with fast dynamic performance. Upon the utility outage, the voltage controller can automatically be activated to regulate the load voltage. Moreover, a novel load current feed forward was proposed, and it can improve the waveform quality of both the grid current in the grid-tied mode and the load voltage in the islanded mode. A advanced control strategy was proposed for three-phase inverter in DG to operate in both islanded and grid-tied modes, with no need for switching between two different control architectures or critical islanding detection.

REFERENCES

- [1] R. C. Dugan and T. E. McDermott, "Distributed generation," *IEEE Ind. Appl. Mag.*, vol. 8, no. 2, pp. 19–25, Mar./Apr. 2002.
- [2] R. H. Lasseter, "Microgrids and distributed generation," *J. Energy Eng.*, vol. 133, no. 3, pp. 144–149, Sep. 2007.
- [3] C. Mozina, "Impact of green power distributed generation," *IEEE Ind. Appl. Mag.*, vol. 16, no. 4, pp. 55–62, Jul./Aug. 2010.
- [4] IEEE Recommended Practice for Utility Interface of Photovoltaic(PV) Systems, *IEEE Standard 929-2000*, 2000.
- [5] IEEE Standard for Interconnecting Distributed Resources with Electric Power Systems, *IEEE Standard 1547-2003*, 2003.
- [6] J. Stevens, R. Bonn, J. Ginn, and S. Gonzalez, *Development and Testing of an Approach to Anti-Islanding in Utility-Interconnected Photovoltaic Systems*. Livermore, CA, USA: Sandia National Laboratories, 2000.
- [7] A. M. Massoud, K. H. Ahmed, S. J. Finney, and B. W. Williams, "Harmonic distortion based island detection technique for inverter-based distributed generation," *IET Renewable Power Gener.*, vol. 3, no. 4, pp. 493–507, Dec. 2009.
- [8] T. Thacker, R. Burgos, F. Wang, and D. Boroyevich, "Single-phase islanding detection based on phase-locked loop stability," in *Proc. 1st IEEE Energy Convers. Congr. Expo.*, San Jose, CA, USA, 2009, pp. 3371–3377.
- [9] S.-K. Kim, J.-H. Jeon, J.-B. Ahn, B. Lee, and S.-H. Kwon, "Frequency shift acceleration control for anti-islanding of a distributed-generation inverter," *IEEE Trans. Ind. Electron.*, vol. 57, no. 2, pp. 494–504, Feb. 2010.
- [10] A. Yafaoui, B. Wu, and S. Kouro, "Improved active frequency drift anti islanding detection method for grid connected photovoltaic systems," *IEEE Trans. Power Electron.*, vol. 27, no. 5, pp. 2367–2375, May 2012.
- [11] J. M. Guerrero, L. Hang, and J. Uceda, "Control of distributed uninterruptible power supply systems," *IEEE Trans. Ind. Electron.*, vol. 55, no. 8, pp. 2845–2859, Aug. 2008.
- [12] M. C. Chandorkar, D. M. Divan, and R. Adapa, "Control of parallel connected inverters in standalone AC supply systems," *IEEE Trans. Ind. Appl.*, vol. 29, no. 1, pp. 136–143, Jan./Feb. 1993.
- [13] Y. Li, D. M. Vilathgamuwa, and P. C. Loh, "Design, analysis, and realtime testing of a controller for multibus microgrid system," *IEEE Trans. Power Electron.*, vol. 19, no. 5, pp. 1195–1204, Sep. 2004.
- [14] F. Gao and M. R. Iravani, "A control strategy for a distributed generation unit in grid-connected and autonomous modes of operation," *IEEE Trans. Power Del.*, vol. 23, no. 2, pp. 850–859, Apr. 2008.
- [15] S.-H. Hu, C.-Y. Kuo, T.-L. Lee, and J. M. Guerrero, "Droop-controlled inverters with seamless transition between islanding and grid-connected

operations,” inProc. 3rd IEEE Energy Convers. Congr. Expo., Phoenix, AZ, USA, 2011, pp. 2196–2201.

[16] L. Arnedo, S. Dwari, V. Blasko, and S. Park, “80 kW hybrid solar inverter for standalone and grid connected applications,” inProc. 27th IEEE Appl. Power Electron. Conf. Expo., Orlando, FL, USA, 2012, pp. 270–276.

[17] R. Tirumala, N. Mohan, and C. Henze, “Seamless transfer of gridconnected PWM inverters between utility-interactive and stand-alone modes,” inProc. 17th IEEE Appl. Power Electron. Conf. Expo., Dallas, TX, USA, 2002, pp. 1081–1086.

[18] R. Teodorescu and F. Blaabjerg, “Flexible control of small wind turbines with grid failure detection operating in stand-alone and grid-connected mode,” IEEE Trans. Power Electron., vol. 19, no. 5, pp. 1323–1332, Sep. 2004.

[19] H. Zeineldin, M. I. Marei, E. F. El-Saadany, and M. M. A. Salama, “Safe controlled islanding of inverter based distributed generation,” inProc. 35th IEEE Power Electron. Spec. Conf., Aachen, Germany, 2004, pp. 2515–2520.

[20] H. Zeineldin, E. F. El-Saadany, and M. M. A. Salama, “Intentional islanding of distributed generation,” in Proc. IEEE Power Eng. Soc. Gen. Meeting, San Francisco, CA, USA, 2005, pp. 1496–1502.

[21] S. Jung, Y. Bae, S. Choi, and H. Kim, “A low cost utility interactive inverter for residential fuel cell generation,” IEEE Trans. Power Electron., vol. 22, no. 6, pp. 2293–2298, Nov. 2007.