

Harmonic Mitigation Analysis of Distribution System in Grid-Connected Microgrids with Fuzzy Logic System



Sk. Asma Bhanu
PG Student,
Department of EEE,
SSN EC,
Ongole, AP, India.



K. Sowjan Kumar
Associate Professor
Department of EEE,
SSN EC,
Ongole, AP, India.

Abstract

To achieve better operation of grid-connected and islanding micro grids, the paper considers a simple harmonic propagation model in which the microgrid is placed at the receiving end of the feeder. The impacts of voltage-controlled and current-controlled distributed generation (DG) units to microgrid resonance propagation are compared. It can be seen that a conventional voltage-controlled DG unit with an LC filter has a short-circuit feature at the selected harmonic frequencies, while a current-controlled DG unit presents an open-circuit characteristic.

To mitigate the feeder harmonic distortions, a modified virtual impedance-based active damping method that consists of a virtual resistor and a virtual nonlinear capacitor is also proposed. The virtual capacitor eliminates the impacts of LCL filter grid-side inductor and the virtual resistor is interfaced to the receiving end of the feeder to provide active damping service. Due to different behaviors at harmonic frequencies, specific harmonic mitigation methods shall be developed for current controlled and voltage-controlled DG units, respectively.

This paper also focuses on developing a voltage-controlled DG unit-based active harmonic damping method for grid-connected and islanding microgrid systems and by using fuzzy logic system we are

controlling the entire system the Simulated results have been obtained from a single-phase low voltage microgrid.

Index Terms— Active power filter, distributed power generation, droop control, grid-connected converter, microgrid, power quality, renewable energy system, resonance propagation, virtual impedance.

I. INTRODUCTION

The microgrid paradigm is emerging as an attractive way to future smart distribution grids, thanks to its capability to operate in both grid-connected and islanded modes. The dynamic islanding operations bring more flexibility on the integration of Distributed Generation (DG) units, and also provide a more reliable electricity service. On the other hand, during the islanded operations, the microgrid usually becomes much weaker and more sensitive to power quality disturbances. Thus, the harmonic distortion tends to be more apparent in an islanded microgrid.

Furthermore, since the use of LCL-filters is gaining a wide acceptance in grid connected converters, the aggregated shunt capacitance for a number of LCL-filters may lead to harmonic resonance with the line inductance, and the consequent harmonic voltage amplification on a distribution feeder. Hence, stringent demands are being imposed on the ancillary services

of inverter-interfaced DG units, such as the mitigation of circulating harmonic current in multiple DG units, harmonic voltage reduction and harmonic resonance damping.

To avoid the adoption of passive damping equipment, various types of active damping methods have been developed.

Among them, the resistive active power filter (R-APF) is often considered as a promising way to realize better performance. Conventionally, the principle of R-APF is to emulate the behavior of passive damping resistors by applying a closed-loop current-controlled method (CCM) to power electronics converters.

In this control category, the R-APF can be simply modeled as a virtual harmonic resistor if it is viewed at the distribution system level. Additionally, a few modified R-APF concepts were also developed in the recent literature. In the discrete tuning method was proposed to adjust damping resistances at different harmonic orders. Accordingly, the R-APF essentially works as a nonlinear resistor. In the operation of multiple R-APFs was also considered, where an interesting droop control was designed to offer autonomous harmonic power sharing ability among parallel R-APFs.

The idea of Resistive-Active Power Filter (R-APF) is implemented based on a high-bandwidth current controller, where DG inverters are controlled to behave as resistors at harmonic frequencies, such that harmonic resonances and voltage distortions can be damped. To autonomously share harmonic currents, a droop relationship between the distorted power of a DG inverter and the controlled harmonic resistance is built. However, it has been shown that only the output voltage of a DG unit is regulated in this method, whereas the voltage at the Point of Connection (PoC) tends to be undamped in the presence of grid-side inductance.

Another popular scheme is based on the virtual output impedance concept, where a load current feed forward loop is introduced together with a high bandwidth output voltage controller. Thus, either the virtual inductance or the virtual resistance can be synthesized at the harmonic frequencies. It is essentially a frequency-dependent voltage droop with the output harmonic currents. As a consequence, the additional harmonic voltage distortions are inevitably increased, and even become more severe when a large virtual inductance is needed to attenuate the differences among the grid-side inductances of DG units.

To alleviate the adverse effect of the grid-side inductance, a PoC voltage feed forward control scheme is developed recently. With a positive gain G in the PoC voltage feed forward loop, the harmonic impedance seen from the PoC of a DG inverter can be scaled down by $1/(1+G)$. Nevertheless, the performance of this scheme is limited on the harmonic resonance damping due to the absence of additional harmonic resistance. To achieve better operation of grid-connected and islanding microgrids, the paper considers a simple harmonic propagation model in which the microgrid is placed at the receiving end of the feeder.

To mitigate the feeder harmonic distortions, a modified virtual impedance-based active damping method that consists of a virtual resistor and a virtual nonlinear capacitor is also proposed. The virtual capacitor eliminates the impacts of LCL filter grid-side inductor and the virtual resistor is interfaced to the receiving end of the feeder to provide active damping service. Simulated results are provided to confirm the validity of the proposed method.

II. SYSTEM MODELING

During the islanded operation, microgrid voltages usually becomes more sensitive to harmonic currents produced from the nonlinear loads, due to the limited power capacity of DG units and the low short-circuit ratio. Moreover, the presence of shunt capacitors tends

to result in harmonic resonance and propagation throughout the microgrid. As a consequence, the mitigation of circulating harmonic current among all the DG units is needed to prevent overloading of some DG inverters, and meanwhile, proper resonance damping measures are also important to suppress harmonic voltage amplifications.

Fig. 1 illustrates an example of a low-voltage microgrid dominated by multiple inverter-interfaced DG units. A static switch is used to dynamically disconnect the microgrid from the upstream distribution system during abnormal conditions.

For the local and common loads, the diode rectifiers are used to denote the nonlinear loads, whereas the shunt capacitors represent the aggregated effect of capacitive loads and the capacitors in the LCL-filters of the grid-connected converters like battery chargers and active front-end rectifiers.

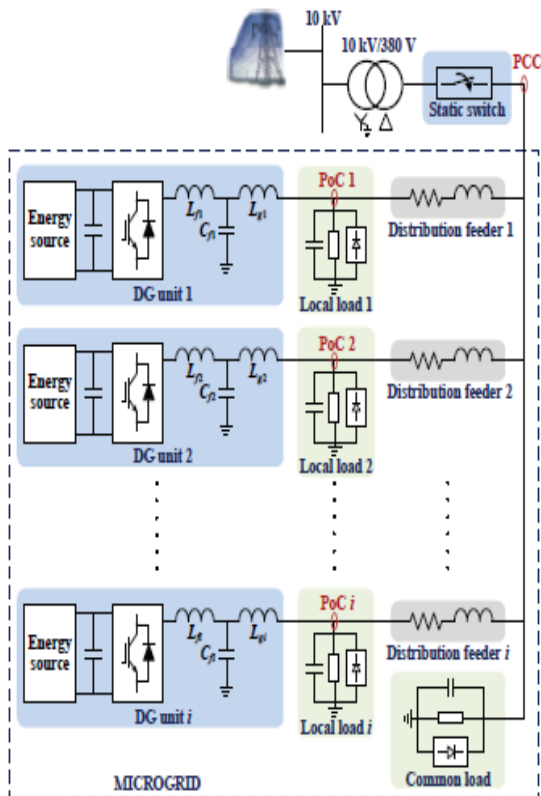


Fig.1. A sample low-voltage microgrid dominated with multiple inverter interfaced DG units.

For the sake of simplicity, this paper only adopts a simple microgrid configuration to demonstrate how the microgrid power quality is affected by resonance propagation. In addition, this paper also assumes that shunt capacitor banks and parasitic feeder capacitances are evenly distributed in the feeder.

Fig. 2 illustrates the configuration of a single-phase microgrid system, where a few DG units are interconnected to the point of common coupling (PCC) through a long underground feeder.

Note that the static transfer switch (STS) controls the operation mode of the microgrid. When the main grid is disconnected from the microgrid, the PCC nonlinear loads shall be supplied by the standalone DG units.

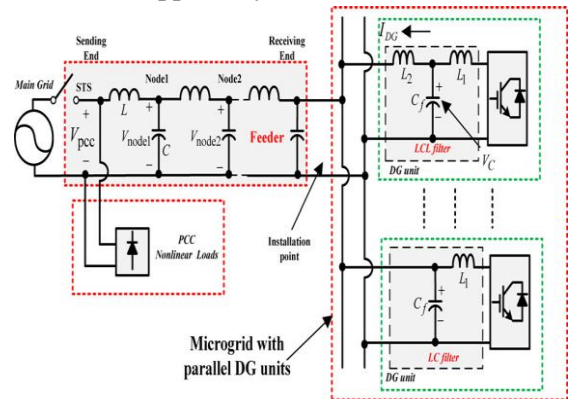


Fig.2. Simplified one-line diagram of a single-phase microgrid.

For a long feeder, as illustrated in Fig. 2, a lumped parameter model is not able to describe its resonance propagation characteristics. Alternatively, the distributed parameter model was discussed, where the voltage distortions at PCC induce a harmonic voltage standing wave along the feeders. To make the discussion more straightforward, we assume that the microgrid in the feeder receiving end only consists of one DG interfacing converter. In the next section, the modeling of resonances in multiple DG-unit-based microgrid is discussed. The previous section focuses on the analysis of grid-tied DG units. For an islanding microgrid system, the VCM operation of DG units is needed for direct voltage support.

FUZZY LOGIC SYSTEM:

In recent years, the number and variety of applications of fuzzy logic have increased significantly. The applications range from consumer products such as cameras, camcorders, washing machines, and microwave ovens to industrial process control, medical instrumentation, decision-support systems, and portfolio selection. In fuzzy Logic Toolbox software, fuzzy logic should be interpreted as FL, that is, fuzzy logic in its wide sense. The basic ideas underlying FL are explained very clearly and insightfully in Foundations of Fuzzy Logic. What might be added is that the basic concept underlying FL is that of a linguistic variable, that is, a variable whose values are words rather than numbers. In effect, much of FL may be viewed as a methodology for computing with words rather than numbers. Although words are inherently less precise than numbers, their use is closer to human intuition. Furthermore, computing with words exploits the tolerance for imprecision and thereby lowers the cost of solution. Among various combinations of methodologies in soft computing, the one that has highest visibility at this juncture is that of fuzzy logic and neuro computing, leading to neuro-fuzzy systems. Within fuzzy logic, such systems play a particularly important role in the induction of rules from observations. An effective method developed by Dr. Roger Jang for this purpose is called ANFIS (Adaptive Neuro-Fuzzy Inference System). This method is an important component of the toolbox.

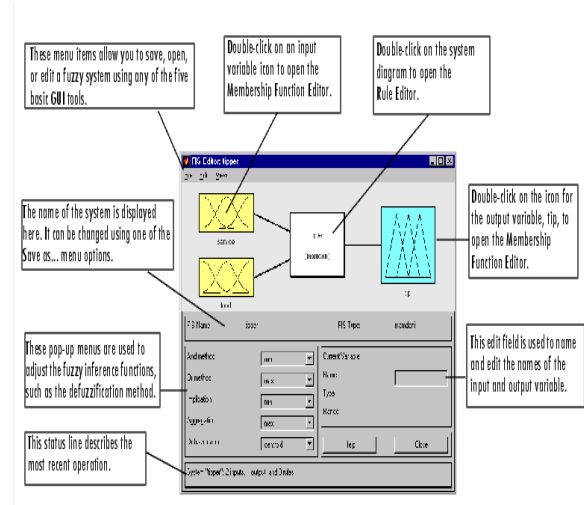


Fig.3b. The FIS Editor

In this paper, a small proportional gain is selected to ensure that there is no noticeable coupling between the fundamental and the harmonic DG voltage tracking.

With aforementioned efforts, the derivative operation is successfully avoided by using the proposed virtual nonlinear capacitor.

III. SIMULATION RESULTS

Simulated results have been obtained from a single-phase low voltage microgrid. To emulate the behavior of six kilometers feeder with distributed parameters, a DG unit with an LCL filter is connected to PCC through a ladder network with six identical LC filter units. Each LC filter represents 1 km feeder.

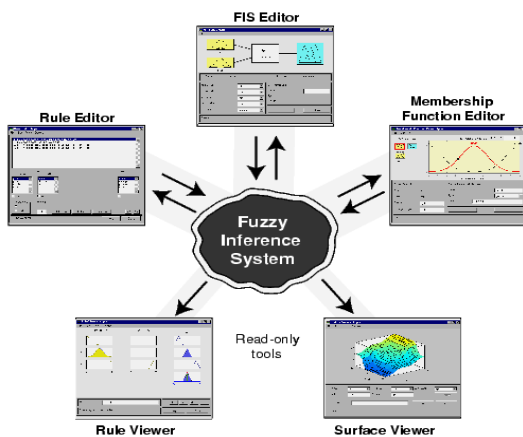


Fig.3.a. The Primary GUI Tools of the Fuzzy Logic

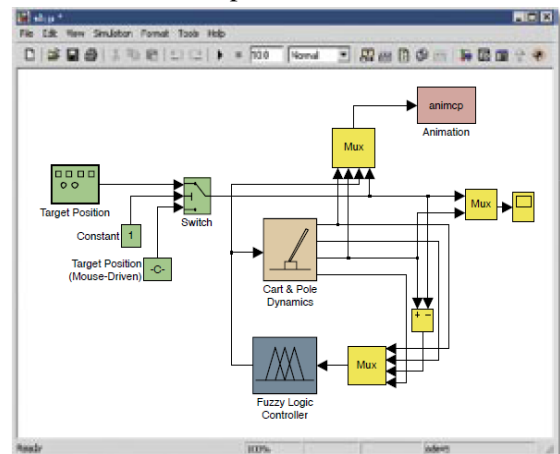


Fig : fuzzy interference system

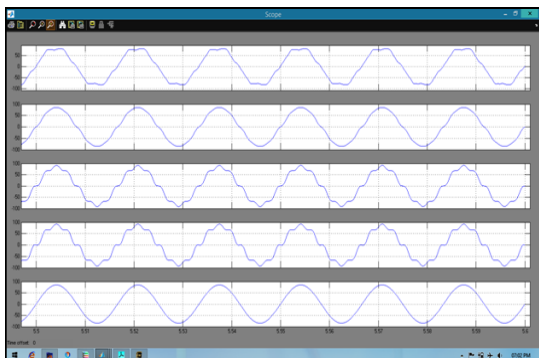


Fig 4 Harmonic voltage amplification during a single DG unit grid connected operation (without damping) (a) PCC voltage (b) node 1 voltage (c) node 3 voltage (d) node 5 voltage (e) DG unit filter capacitor voltage.

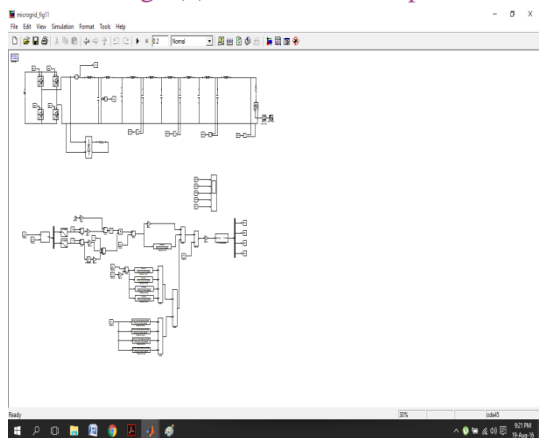


Fig 5 simulation circuit of harmonic voltage amplification during a single dg unit grid connected operation (with virtual nonlinear capacitor and resistor based active damping)

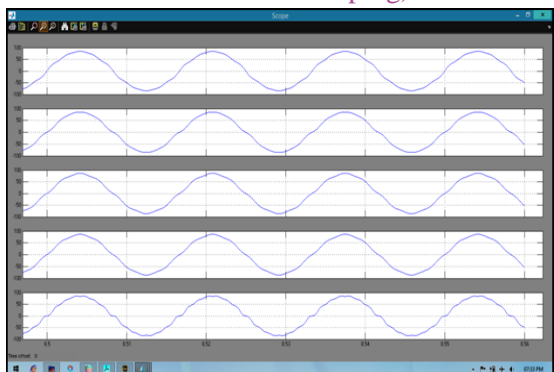


Fig 6 Harmonic voltage amplification during a single DG unit grid connected operation (with virtual nonlinear capacitor and resistor based active damping) (a) PCC voltage (b) node 1 voltage (c) node 3 voltage (d) node 5 voltage (e) DG unit filter capacitor voltage.

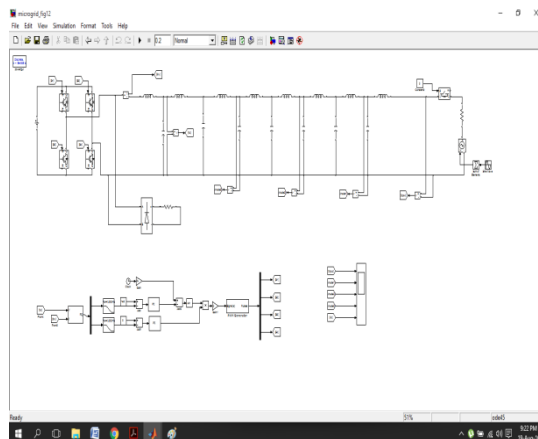


Fig 7 simulation circuit of harmonic voltage amplification during a single dg unit islanding operation (without damping)

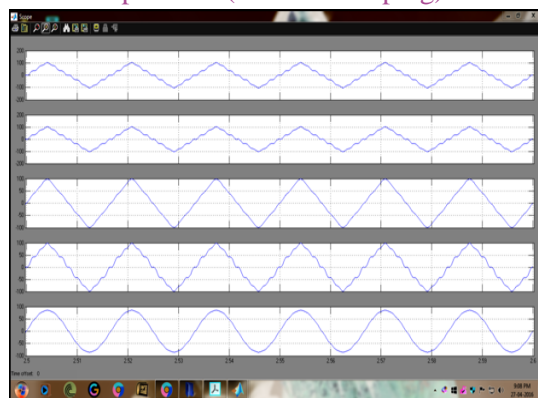


Fig 8 Harmonic voltage amplification during a single DG unit islanding operation (without damping) (a) PCC voltage (b) node 1 voltage (c) node 3 voltage (d) node 5 voltage (e) DG unit filter capacitor voltage.

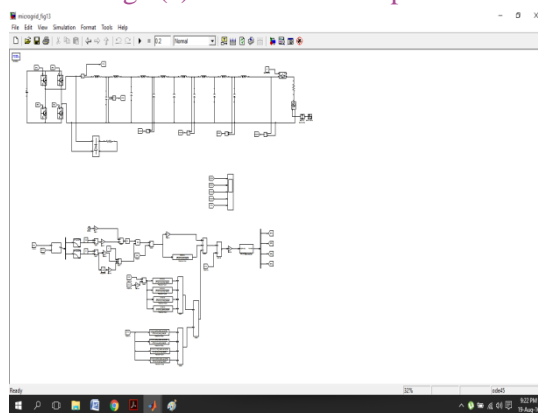


Fig 9 simulation circuit of harmonic voltage amplification during a single dg unit islanding operation (with virtual nonlinear capacitor and resistor based active damping)

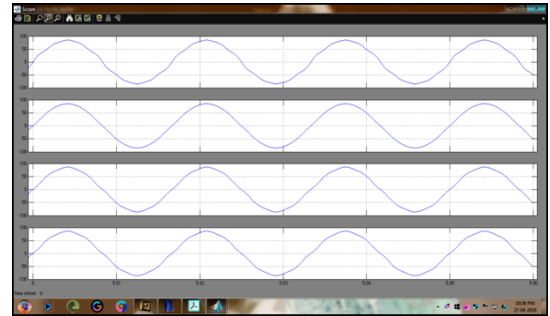
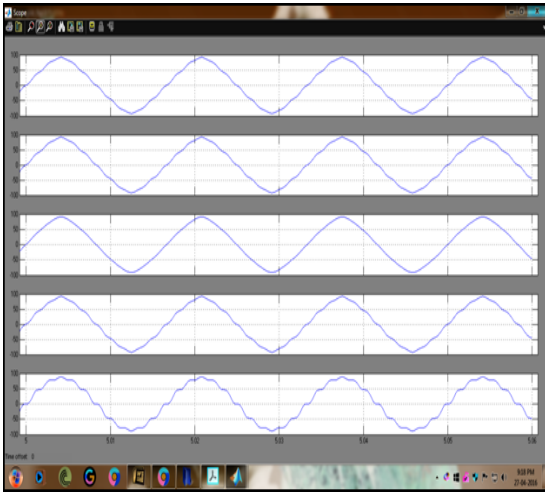


Fig 10 Harmonic voltage amplification during a single DG unit islanding operation (with virtual nonlinear capacitor and resistor based active damping) (a) PCC voltage (b) node 1 voltage (c) node 3 voltage (d) node 5 voltage (e) DG unit filter capacitor voltage.

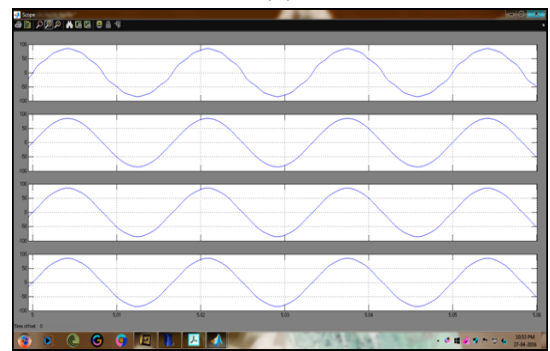


Fig 12 Harmonic voltage amplification along the feeders (grid-tied operation of two parallel DG units)

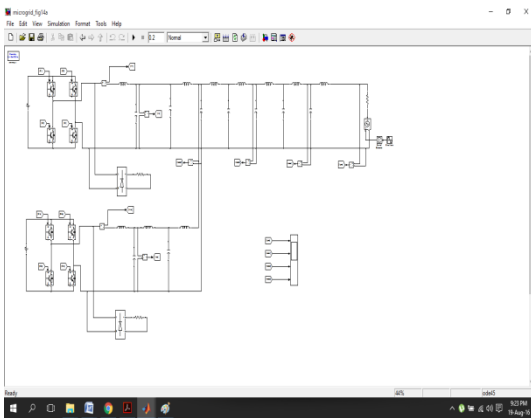


Fig 11 Harmonic voltage amplification along the feeders (grid-tied operation of two parallel DG units)



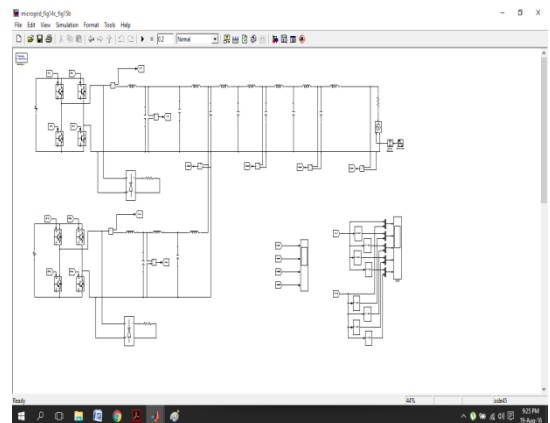



Fig 13 dg unit 1 and dg unit 2 line currents and their harmonic components (grid-tied operation of two parallel dg units)

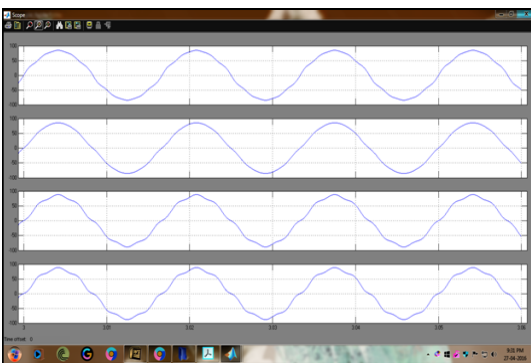

(a)

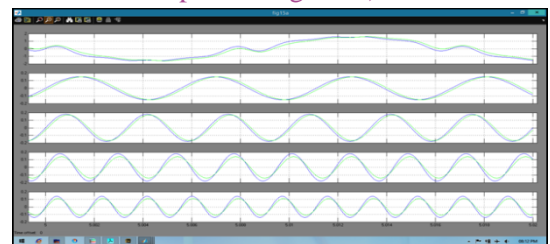

(a)

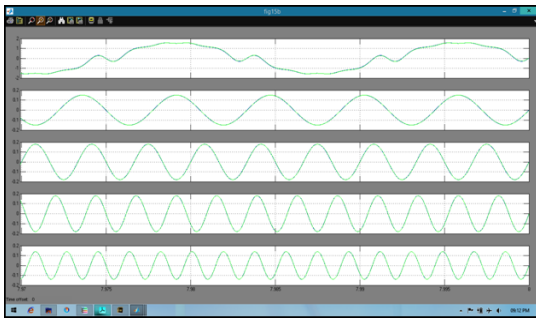

(b)

Fig 14 dg unit 1 and dg unit 2 line currents and their harmonic components (grid-tied operation of two parallel dg units)

IV. CONCLUSION

In this paper, a microgrid resonance propagation model is analyzed. To dynamically mitigate the resonance using DG units, an improved DG unit control scheme to uses the concept of virtual impedance is proposed. Particularly, the capacitive component of the proposed nonlinear virtual impedance is used to balance the impact of DG unit *LCL* filter grid-side inductor. The resistive component is accountable for active damping. With appropriately controlled DG equivalent harmonic impedance at chosen harmonic frequencies, the proposed method can also reduce the harmonic circulating current among multiple DG units with mismatched output filter parameters. Comprehensive simulations are conducted to confirm the validity of the proposed method.

V. REFERENCES

[1] H. Akagi, "Active harmonic filters," *Proc. IEEE*, vol. 93, no. 12, pp. 2128–2141, Dec. 2005.

[2] H. Akagi, H. Fujita, and K. Wada, "A shunt active filter based on voltage detection for harmonic termination for radial power distribution system," *IEEE Trans. Ind. Appl.*, vol. 35, no. 4, pp. 682–690, Jul./Aug. 1995.

[3] K. Wada, H. Fujita, and H. Akagi, "Consideration of a shunt active filter based on voltage detection for

installation on a long distribution feeder," *IEEE Trans. Ind. Appl.*, vol. 38, no. 4, pp. 1123–1130, Jul./Aug. 2002.

[4] P.-T. Cheng and T.-L. Lee, "Distributed active filter systems (DAFSs): A new approach to power system harmonics," *IEEE Trans. Ind. Appl.*, vol. 42, no. 5, pp. 1301–1309, Sep./Oct. 2006.

[5] T.-L. Lee and P.-T. Cheng, "Design of a new cooperative harmonic filtering strategy for distributed generation interface converters in an islanding network," *IEEE Trans. Power Electron.*, vol. 42, no. 5, pp. 1301–1309, Sep. 2007.

[6] T.-L. Lee, J.-C. Li, and P.-T. Cheng, "Discrete frequency-tuning active filter for power system harmonics," *IEEE Trans. Power Electron.*, vol. 24, no. 5, pp. 1209–1217, Apr. 2009.

[7] T.-L. Lee and S.-H. Hu, "Discrete frequency-tuning active filter to suppress harmonic resonances of closed-loop distribution power system," *IEEE Trans. Power Electron.*, vol. 26, no. 1, pp. 137–148, Dec. 2010.

[8] N. Pogaku and T. C. Green, "Harmonic mitigation throughout a distribution system: A distributed-generator-based solution," *IEE Proc. Gener. Transmiss. Distrib.*, vol. 153, no. 3, pp. 350–358, May 2006.

[9] C. J. Gajanayake, D. M. Vilathgamuwa, P. C. Loh, R. Teodorescu, and F. Blaabjerg, "Z-source-inverter-based flexible distributed generation system solution for grid power quality improvement," *IEEE Trans. Energy Convers.*, vol. 24, pp. 695–704, Sep. 2009.

[10] Y.W. Li, D. M. Vilathgamuwa, and P. C. Loh, "Design, analysis and realtime testing of a controller for multibus microgrid system," *IEEE Trans. Power Electron.*, vol. 19, no. 5, pp. 1195–1204, Sep. 2004.



[11] Q.-C. Zhong and G. Weiss, "Synchronverters: Inverters that mimic synchronous generators," *IEEE Trans. Ind. Electron.*, vol. 58, no. 4, pp. 1259– 1267, Apr. 2011.

Author's Profile:

Sk.Asma Bhanu has received the B.Tech (Electrical and Electronics Engineering) degree from GNITS, hyderabad in 2014 and persuing M.Tech (Electrical Power Systems) in SSN engineering college , ongole, AP, India.

K.Sowjan Kumar has 13 years of experience in teaching in Graduate and Post Graduate level and he Presently working as Associate Professor and HOD of EEE department in SSN EC, ongole, AP, India.